



TYPICAL TRANSFORMER PLACEMENT

(NOT TO SCALE)

PLAN VIEW

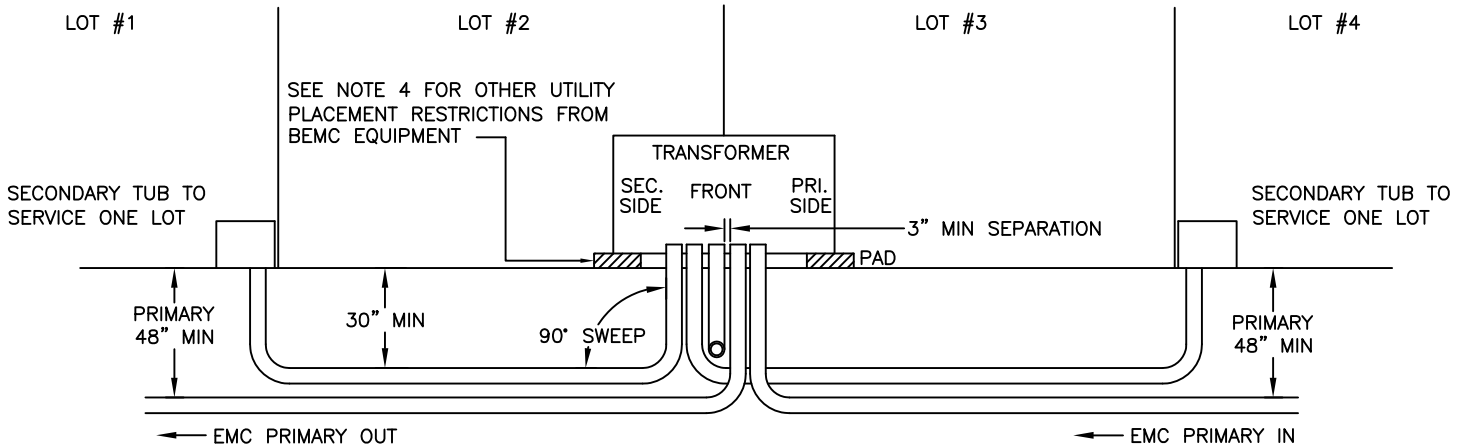

AERIAL VIEW

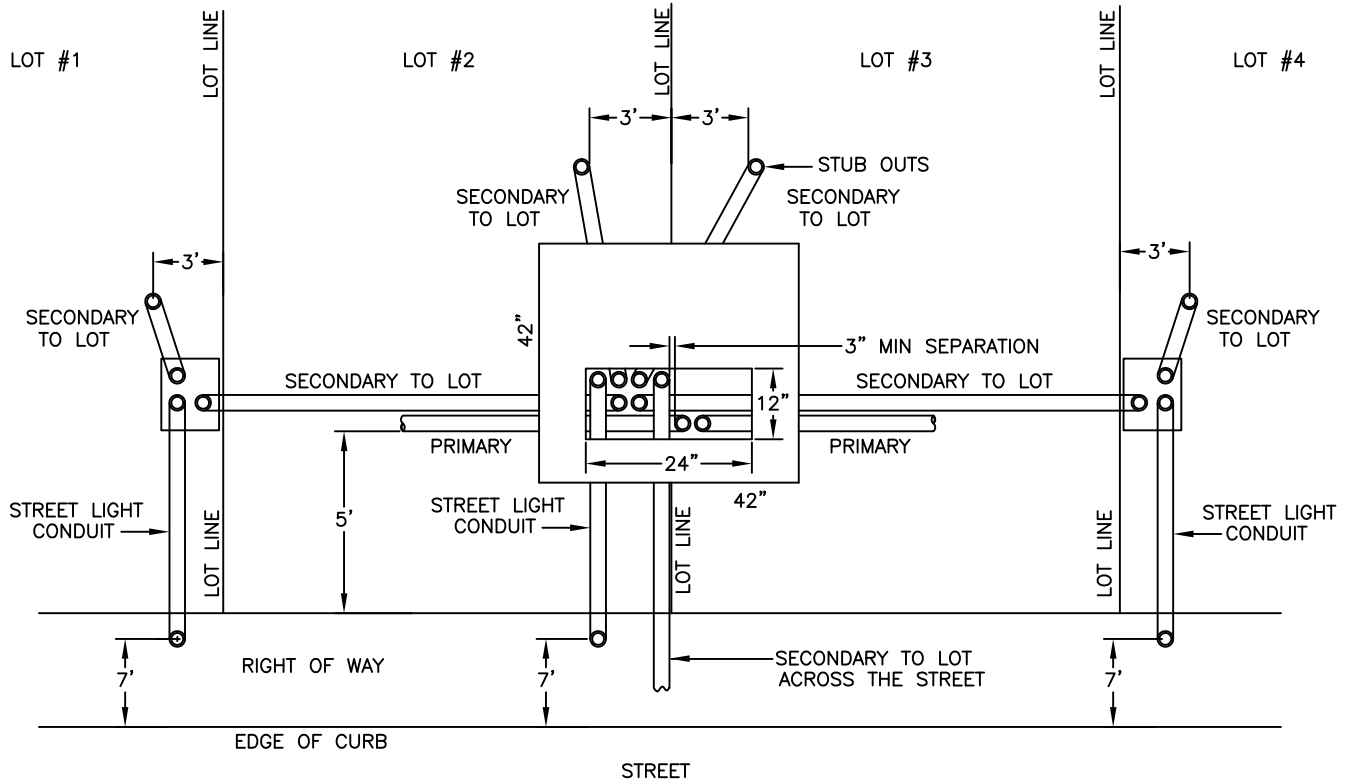

NOTES:

- 1) USE SCHEDULE 40 PVC GRAY ELECTRICAL CONDUIT AND 90° SWEEPS ONLY (MINIMUM 18" RADIUS). NO WATER PIPE.
- 2) ALL CONDUIT MUST HAVE CAPS.
- 3) INSTALL 12501b MULE TAPE IN ALL CONDUIT.
- 4) SET BACK FROM OTHER UTILITIES SHALL BE 1' MINIMUM AWAY FROM SIDES AND BACK. NO UTILITIES IN FRONT OF TRANSFORMER THERE IS A MINIMUM SET BACK OF 4' AWAY FROM FIRE HYDRANTS.
- 5) ANY UTILITY OTHER THAN BALDWIN EMC SHALL CONSIST OF, BUT NOT LIMITED TO, TELEPHONE, CABLE TV, GAS, WATER AND SEWER.
- 6) INSTALL WARNING TAPE 12" TO 24" DEEP. EMC WILL NOT FURNISH TAPE.
- 7) CENTER SECONDARY TUB ON LOT LINE WHEN SERVING TWO LOTS.
- 8) THE CONDUIT FOR PRIMARY MUST BE SEPARATED FROM THE CONDUIT FOR SECONDARY BY A MINIMUM OF 3 INCHES IN THE TRANSFORMER.

DWN. BY:	DATE:
D. LITTLE	7/24/13
ENG. APPROV:	
B. SEALS	7/24/13

TITLE:		
TRANSFORMER PLACEMENT IN UG SUBDIVISIONS		
SCALE:	N.T.S.	SHEET 1 OF 1